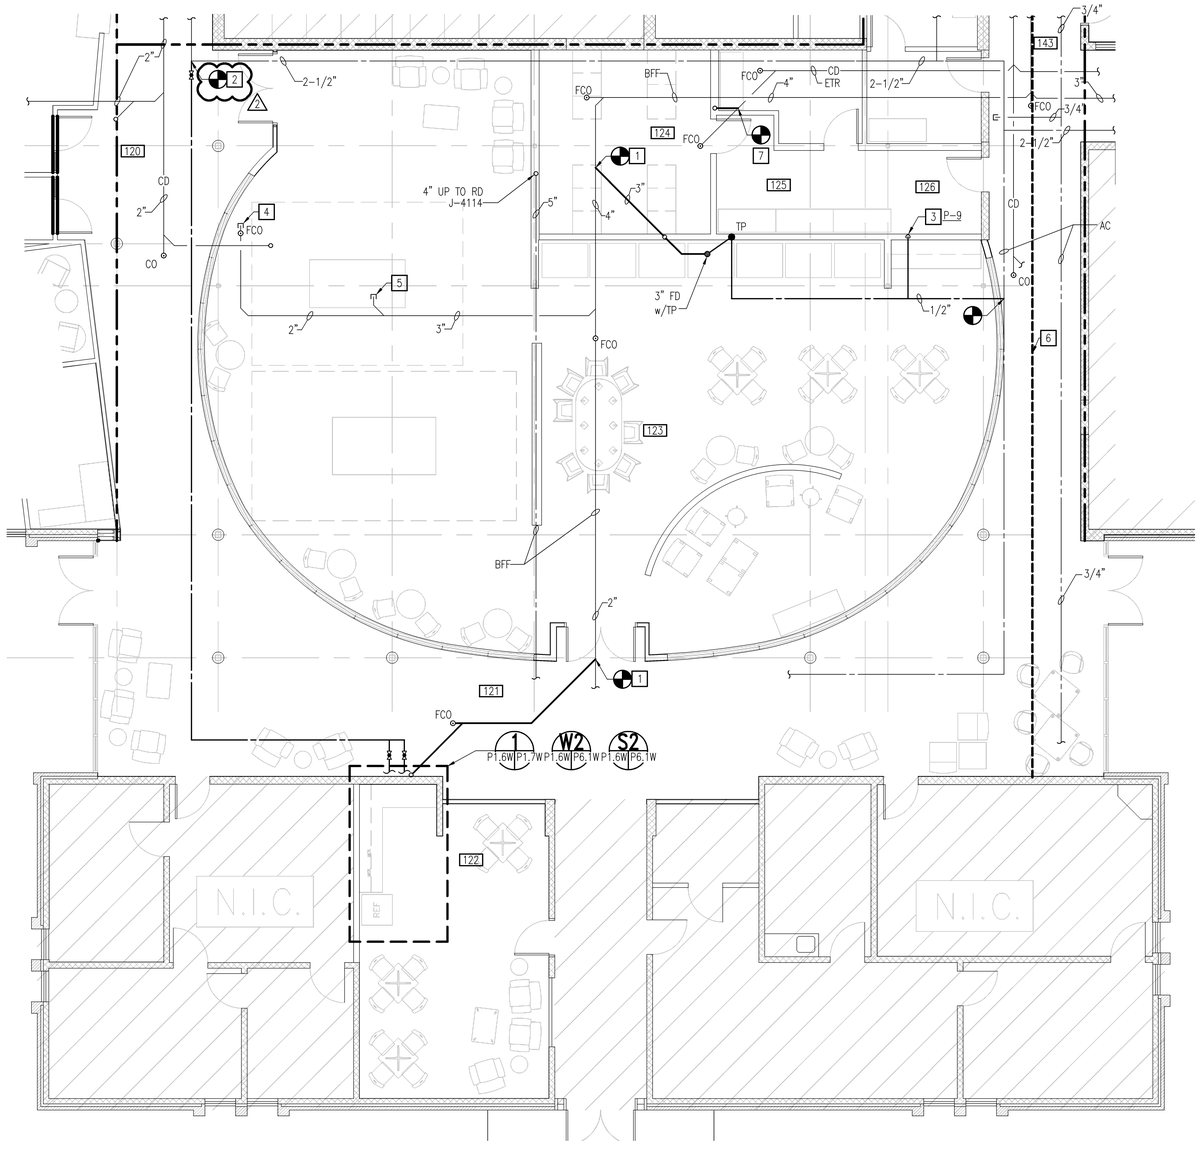

NOTES THIS SHEET

1. CONNECT TO EXISTING WASTE BELOW FLOOR.
2. PROVIDE NEW ISOLATION VALVE. (1)
3. PROVIDE WATER SHUT OFF VALVE IN CABINET FOR COFFEE MAKER.
4. PROVIDE 2" CAP BELOW FLOOR.
5. PROVIDE 3" CAP BELOW FLOOR.
6. PHASING WALL. REFER TO ARCHITECTURAL DRAWINGS.
7. CONNECT COORDINATE IN FLOOR ANR RUN PIPE INTO NEW WALL

NOTE TO CONTRACTOR

ALL PIPE IS EXISTING TO REMAIN UNLESS OTHERWISE INDICATED.

SECTION 1 ROOM SCHEDULE

120	CORRIDOR
121	CORRIDOR
122	FACULTY LOUNGE
123	STUDENT LOUNGE
124	SERVERS
125	TECH
125A	OFFICE

WARSAW CAMPUS PLUMBING NEW WORK FLOOR PLAN

SCALE: 3/16" = 1'-0"



KEYPLAN

NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

nbj ARCHITECTURE
A Partnership of Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS PLUMBING NEW WORK FLOOR PLAN

Date: MARCH 3, 2010

REVISIONS

NO.	DATE
1	FEBRUARY 9, 2010
2	MARCH 3, 2010

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-490-7220

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
PROFESSIONAL ENGINEER

Sheet
P1.6W

File Number
9004